

Overhead Secondary To Under-ground Meter Base Installation

Customer Wiring Size



Yazoo Valley EPA
"Strong on Service"


*****COPPER*****

Meter Size	Conduit Size	Conductor Wire Size	Neutral Wire Size	Ground Wire Size
60 amp	1"	#4	#4	Bare #6 Copper
100 amp	2"	#2	#4	Bare #6 Copper
200 amp	2"	#2/0	#1/0	Bare #4 Copper

*****ALUMINUM*****

Meter Size	Conduit Size	Conductor Wire Size	Neutral Wire Size	Ground Wire Size
60 amp	1"	#2	#4	Bare #6 Copper
100 amp	2"	#1/0	#2	Bare #6 Copper
200 amp	2"	#4/0	#2/0	Bare #4 Copper

*4th Wire Shall Be #6 Insulated Wire

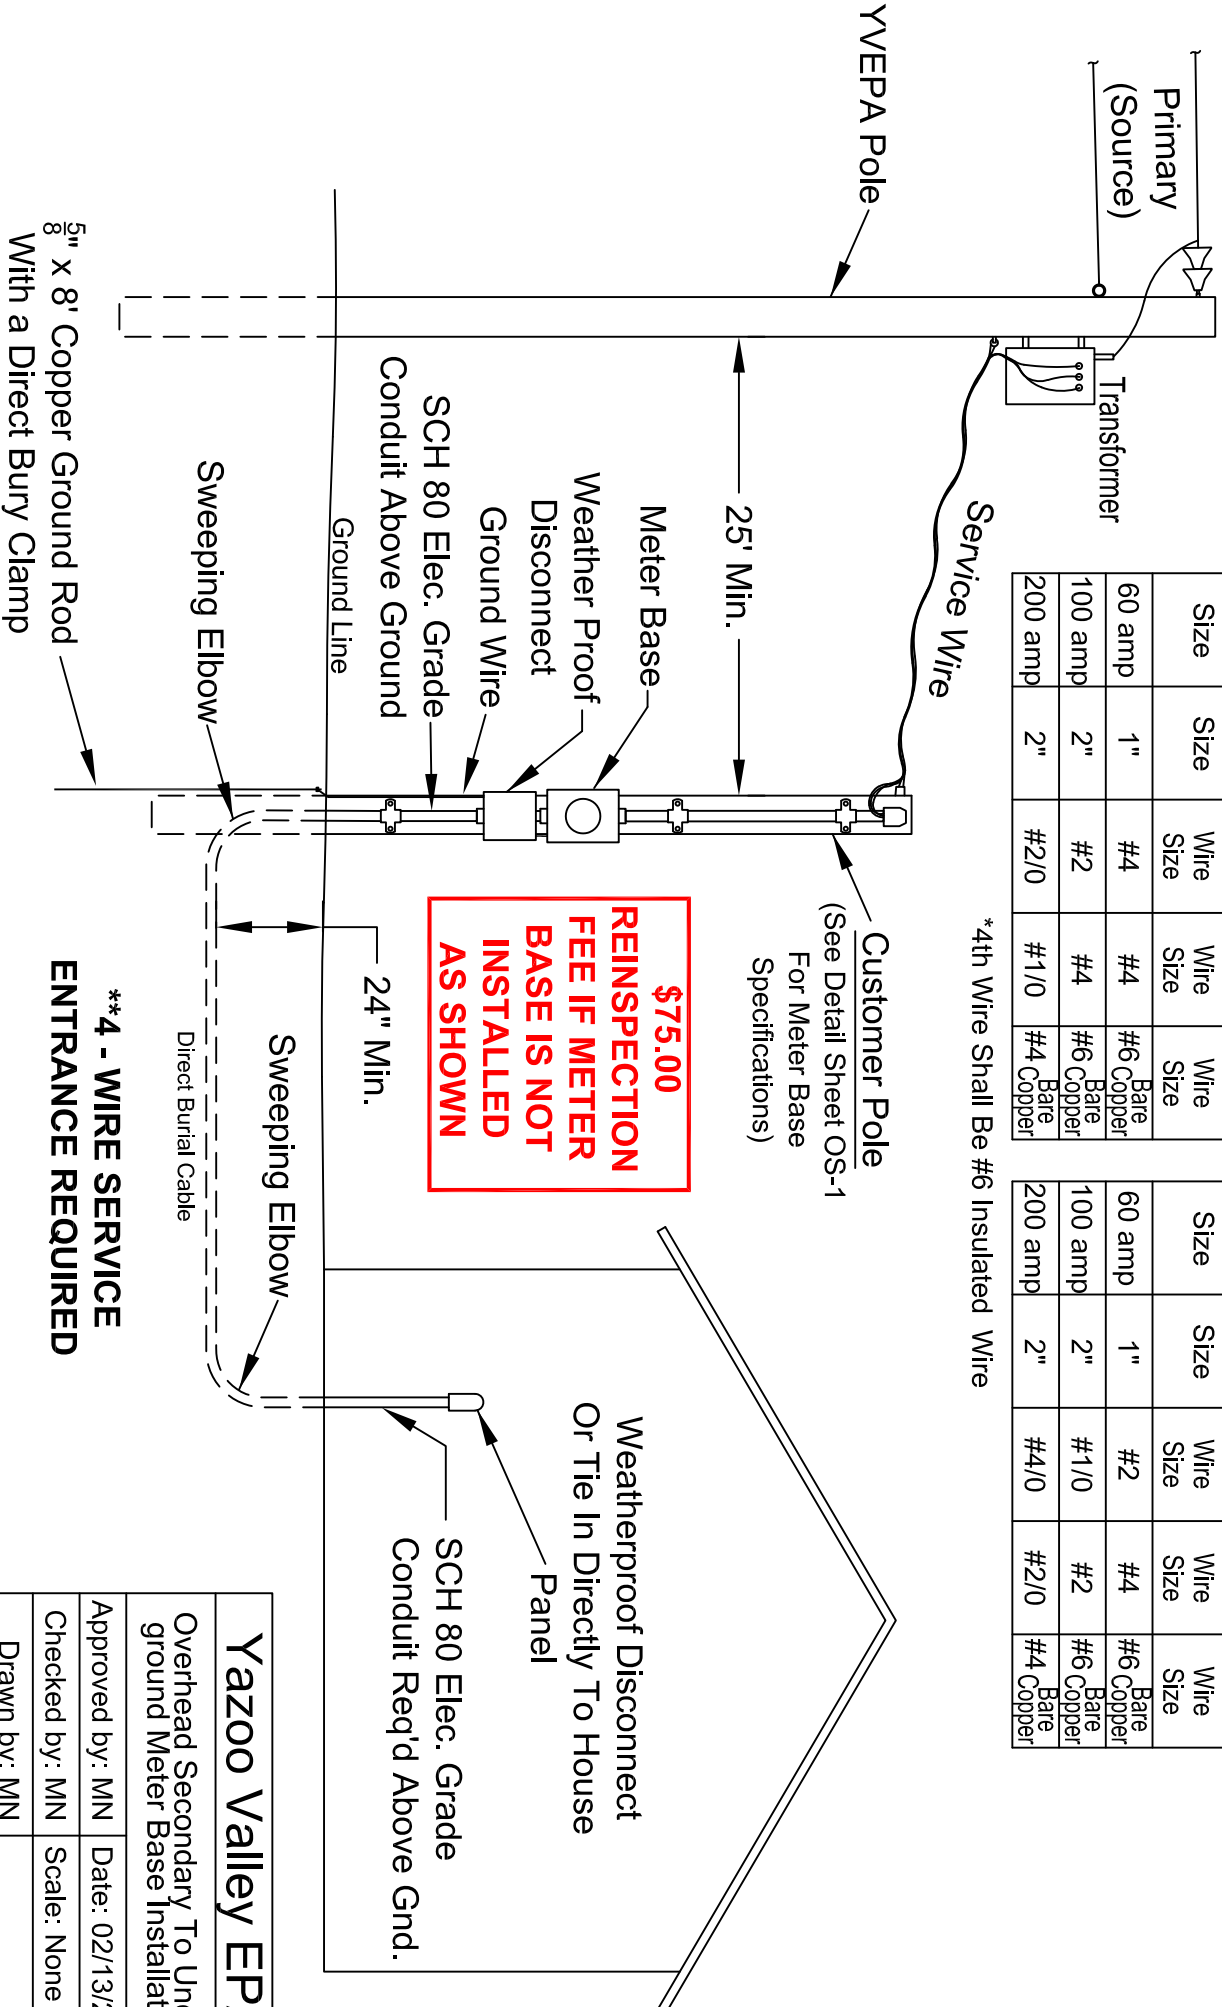

****4 - WIRE SERVICE ENTRANCE REQUIRED**

Yazoo Valley EPA

Overhead Secondary To Under-ground Meter Base Installation

Approved by: MN Date: 02/13/2015

Checked by: MN Scale: None

Drawn by: MN

Revised by RB Date: 2/8/2024